

ABB MEASUREMENT & ANALYTICS | DATA SHEET

TTH300

Head-mount temperature transmitter



Measurement made easy

Temperature transmitter for all communications protocols.
Redundancy thanks to two inputs

Reliable temperature measurement for highest demands

- High accuracy, reliability and durability
- Specific sensor linearization via Callendar-Van Dusen coefficients and with value pair table (32 points)
- Approved for custody transfer measurements by MID certificate in accordance with Measuring Instruments Directive guideline 2014/32/EU
- Suited for ambient temperatures from -50 °C (-58 °F)

Input circuit and communication

- Two universal sensor inputs for resistance thermometers (e.g. $2 \times \text{Pt100}$ in three-wire circuit) and thermocouples
- 4 to 20 mA, HART[®], PROFIBUS PA[®], FOUNDATION Fieldbus[®]

Safety

- Global approvals for explosion protection up to Zone 0
- Functional safety SIL 2 / SIL 3 in accordance with IEC 61508 (HART)
- Device versioning in accordance with NE 53
- Continuous monitoring of supply voltage
- Wire break / corrosion monitoring in accordance with NE 89
- Extended diagnosis in accordance with NE 107 sensor drift monitoring

Configuration

- In accordance with FDT / DTM, EDD or FDI Standard (FIM)
- Turnable LCD indicator with operating buttons

Specification

CE Marking

The device fulfills all requirements for CE marking in accordance with all applicable guidelines.

Electrical isolation

3.5 kV DC (approx. 2.5 kV AC), 60 s, input to output

MTBF (Mean Time Between Failures)

190 years at 40 °C (104 °F) mean ambient temperature

Input filter

50 / 60 Hz

Switch-on delay

- HART: < 10 s ($I_a \leq 3.6$ mA during switch-on cycle)
- PROFIBUS: 10 s, max. 30 s
- FOUNDATION Fieldbus: < 10 s

Warm-up time

5 minutes

Rise time t_{90}

400 to 1000 ms

Measured value update

10/s with 1 sensor, 5/s with 2 sensors, depending on sensor type and sensor circuit

Output filter

Digital filter 1 order: 0 to 100 s

Weight

50 g

Material

- Housing: polycarbonate
- Color: gray RAL9002
- Encapsulation resin: polyurethane (PUR), WEVO PU-417

Installation conditions

- Mounting position: no restrictions
- Installation options:
 - Connection heads in accordance with DIN 43729 form B
 - Rail mounting (35 mm) in accordance with EN 60175 by means of latching base
 - Field mount housing

Electrical connection

- Terminals with captive stainless steel screws, including soldering tags
- Lines up to a maximum of 1.5 mm² (AWG 16)
- Connection for handheld terminal

Dimensions

See chapter **Dimensions** on page 17.

Ambient conditions

Ambient temperature

- Standard: -40 to 85 °C (-40 to 185 °F)
- Optional: -50 to 85 °C (-58 to 185 °F)
- Restricted range during operation with LCD-indicator: -20 to 70 °C (-4 to 158 °F)
- Restricted range during operation with explosion-proof design: see corresponding certificate

Transport- / Storage temperature

-50 to 85 °C (-58 to 185 °F)

Climate class in accordance with DIN EN 60654-1

Cx -40 to 85 °C (-40 to 185 °F) at 5 to 95 % relative air humidity

Max. permissible humidity in accordance with IEC 60068-2-30

100 % relative air humidity

Vibration resistance in accordance with IEC 60068-2-6

10 to 2000 Hz at 5 g, during operation and transport

Shock resistance in accordance with IEC 68-2-27

$g_n = 30$, during operation and transport

IP rating

- Power supply circuit: IP 20
- Measurement current circuit: IP 00 or IP-rating of installation housing

... Specification

Electromagnetic compatibility

Emitted interference in accordance with IEC EN 61326 and Namur NE 21.

Interference-resistant in accordance with IEC 61326 and Namur NE 21.

Pt100: measuring range 0 to 100 °C (32 to 212 °F), span 100 K

Type of test	Testing accuracy	Effect
Burst to signal- / data lines	2 kV	< 0.5 %
Static discharge		
• Contact plate (indirect)	8 kV	No
• Supply terminals*	6 kV	No
• Sensor terminals*	4 kV	No
Radiated field		
80 MHz to 2 GHz	10 V/m	< 0.5 %
Coupling		
150 kHz to 80 MHz	10 V	< 0.5 %
Surge		
between the supply lines	0.5 kV	No malfunction
Line to ground	1 kV	

* Air discharge (at 1 mm (0.04 in) distance)

SIL functional safety

Only for devices with HART communication.

With conformity according to IEC 61508 for the use in safety relevant applications up to and including SIL 3 (redundant).

- In the use of one transmitter the device fulfills the requirements according to SIL 2.
- In the use of redundant handled transmitters the requirements can be fulfilled according to SIL 3.

Instructions on this can be found in the SIL-Safety Manual.

Type A and type AS LCD indicators



Figure 1: (A) LCD indicator Type A (B) LCD indicator Type AS

The LCD indicator type AS has a display function; the LCD indicator type A allows additional configuration functions to be carried out.

Both LCD indicators can only be ordered in conjunction with temperature transmitter.

CE-Marking

The type A and type AS LCD indicator fulfill all requirements for CE marking in accordance with all applicable guidelines.

Properties

Transmitter-controlled graphic (alphanumeric) LCD indicator

- Character height, mode-dependent
- Sign, 4 digits, 2 decimal places
- Bargraph display
- Turnable in 12 increments of 30° each

Display options

- Sensor 1 process value
- Sensor 2 process value
- Electronics- / ambient temperature
- Output value
- Output %

Display diagnostic information related to transmitter and sensor status

Specification

Temperature range

-20 to 70 °C (-4 to 158 °F)

Restricted display function (contrast, reaction time) in the temperature ranges:

- -50 to -20 °C (-58 to -4 °F)
- or
- 70 to 85 °C (158 to 185 °F)

Humidity

0 to 100 %, condensation permitted

Configuration function

- Sensor configuration for standard sensors
- Measuring range
- Behavior in the event of a fault (HART)
- Software write protection for configuration data
- Device address for HART and PROFIBUS PA

Input - resistance thermometer / resistances**Resistance thermometer**

- Pt100 in accordance with IEC 60751, JIS C1604, MIL-T-24388
- Ni in accordance with DIN 43760
- Cu in accordance with recommendation OIML R 84

Resistance measurement

- 0 to 500 Ω
- 0 to 5000 Ω

Sensor connection type

Two-, three-, four-wire circuit

Connection lead

- Maximum sensor line resistance per line 50 Ω in accordance with NE 89
- Three-wire circuit:
Symmetrical sensor line resistances
- Two-wire circuit:
Compensation up to 100 Ω total lead resistance

Measurement current

< 300 μA

Sensor short circuit

< 5 Ω (for resistance thermometer)

Sensor wire break

- Measuring range: 0 to 500 Ω > 0.6 to 10 kΩ
- Measuring range: 0 to 5 Ω > 5.3 to 10 kΩ

Corrosion detection in accordance with NE 89

- Three-wire resistance measurement > 50 Ω
- Four-wire resistance measurement > 50 Ω

Sensor error signaling

- Resistance thermometer:
Sensor short circuit and sensor wire break
- Linear resistance measurement:
Sensor wire break

... Specification

Input - thermocouples / voltages

Types

- B, E, J, K, N, R, S, T in accordance with IEC 60584
- U, L in accordance with DIN 43710
- C, D in accordance with ASTM E-988

Voltages

- -125 to 125 mV
- -125 to 1100 mV

Connection lead

- Maximum sensor line resistance:
per line 1.5 k Ω , total 3 k Ω

Sensor wire break monitoring in accordance with NE 89

- Pulsed with 1 μ A outside measurement interval
- Thermocouple measurement 5.3 to 10 k Ω
- Voltage measurement 5.3 to 10 k Ω

Input resistance

> 10 M Ω

Internal reference junction Pt1000, IEC 60751 Cl. B

(no additional jumpers necessary)

Sensor error signaling

- Thermocouple:
Sensor wire break
- Linear voltage measurement:
Sensor wire break

Functionality input

Freestyle characteristic / 32-points-sampling point table

- Resistance measurement up to a maximum of 5 k Ω
- Voltages up to maximum 1.1 V

Sensor error adjustment

- Through Callendar-Van Dusen coefficients
- Through value table, 32 support points
- Through single-point adjustment (offset adjustment)
- Through two-point adjustment

Input functionality

- 1 Sensor
- 2 Sensors:
mean measurement,
differential measurement,
sensor redundancy,
Sensor drift monitoring

HART® output

Transmission characteristics

- Temperature linear
- Resistance linear
- Voltage linear

Output signal

- Configurable 4 to 20 mA (standard)
- Configurable 20 to 4 mA
(Dynamic range: 3.8 to 20.5 mA in accordance with NE 43)

Simulation mode

3.5 to 23.6 mA

Induced current consumption

< 3.5 mA

Maximum output current

23.6 mA

Configurable error current signal

- Overrange 22 mA (20.0 to 23.6 mA)
- Underrange 3.6 mA (3.5 to 4.0 mA)

PROFIBUS PA® output

Output signal

- PROFIBUS – MBP (IEC 61158-2)
- Baud rate 31.25 kBit/s
- PA-Profile 3.01
- FISCO compliant (IEC 60079-27)
- ID-Number: 0x3470 [0x9700]

Error current signal

- FDE (Fault Disconnection Electronic)

Block structure

- Physical Block
- Transducer Block 1 – Temperature
- Transducer Block 2 – HMI (LCD indicator)
- Transducer Block 3 – enhanced diagnosis
- Analog Input 1 – Primary Value (Calculated Value*)
- Analog Input 2 – SECONDARY VALUE_1 (Sensor 1)
- Analog Input 3 – SECONDARY VALUE_2 (Sensor 2)
- Analog Input 4 – SECONDARY VALUE_3 (reference junction temperature)
- Analog Output – optional HMI display (Transducer Block 2)
- Discrete Input 1 – extended diagnosis 1 (Transducer Block 3)
- Discrete Input 2 – extended diagnosis 2 (Transducer Block 3)

* Sensor 1, Sensor 2 or difference or mean

FOUNDATION Fieldbus® output

Output signal

- FOUNDATION Fieldbus H1 (IEC 611582-2)
- Baud rate 31.25 kBit/s, ITK 5.x
- FISCO compliant (IEC 60079-27)
- Device ID: 000320001F...

Error current signal

- FDE (Fault Disconnection Electronic)

Block structure*

- Resource Block
- Transducer Block 1 – Temperature
- Transducer Block 2 – HMI (LCD indicator)
- Transducer Block 3 – enhanced diagnosis
- Analog Input 1 – PRIMARY_VALUE_1 (Sensor 1)
- Analog Input 2 – PRIMARY_VALUE_2 (Sensor 2)
- Analog Input 3 – PRIMARY_VALUE_3 (Calculated Value**)
- Analog Input 4 – SECONDARY_VALUE (reference junction temperature)
- Analog Output – optional HMI display (Transducer Block 2)
- Discrete Input 1 – extended diagnosis 1 (Transducer Block 3)
- Discrete Input 2 – extended diagnosis 2 (Transducer Block 3)
- PID – PID controller

LAS (Link Active Scheduler) link master functionality

* For the block description, block index, execution times, and block class, refer to the interface description

** Sensor 1, Sensor 2 or difference or mean

... Specification

Power supply

Two-wire technology, polarity safe; power supply lines = signal lines

Note

Following calculations apply for standard applications. This should be taken into consideration when working with a higher maximum current.

Power supply – HART®

Input terminal voltage

- Non-Ex application:
 $U_S = 11$ to 42 V DC
- Ex applications:
 $U_S = 11$ to 30 V DC

Maximum permissible residual ripple for input terminal voltage


During communication this complies with the HART FSK 'Physical Layer' specification.

Undervoltage detection on the transmitter

If the terminal voltage on the transmitter down-scales a value of 10 V, this may lead to an output current of $I_a \leq 3.6$ mA.

Maximum load

$$R_B = (\text{supply voltage} - 11 \text{ V}) / 0.022 \text{ A}$$

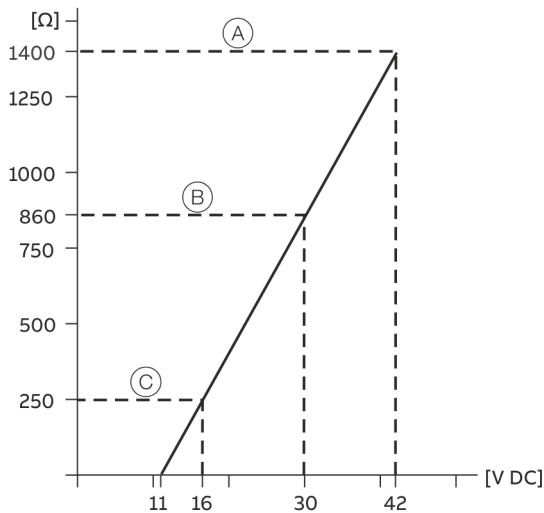

- (A) TTH300
 (B) TTH300 in Ex-applications
 (C) HART communication resistance

Figure 2: Maximum load depending on input terminal voltage

Maximum power

$$P = U_S \times 0.022 \text{ A}$$

$$\text{E. G.: } U_S = 24 \text{ V} \rightarrow P_{\max} = 0.528 \text{ W}$$

Power supply – PROFIBUS® / FOUNDATION Fieldbus®

Input terminal voltage

- Non-Ex application:
 $U_S = 9$ to 32 V DC
- Ex-applications:
 $U_S = 9$ to $17,5$ V DC (FISCO)
 $U_S = 9$ to 24 V DC (Fieldbus Entity model I.S.)

Current consumption

$$\leq 12 \text{ mA}$$

Measuring accuracy

Includes linearity error, repeatability / hysteresis at 23 °C (73.4 °F) ± 5 K and 20 V supply voltage.

Information on measuring accuracy corresponds to 3 σ (Gaussian distribution).

Long-term drift: ±0.05 °C (±0.09 °F) or ±0.05 %* per year, the larger value applies.

Sensor	Measuring range limit	Minimum span	Measuring accuracy		
			Input (24-bit AD-converter)	Analog output* (16-Bit D / A-converter)	
Resistance thermometer / resistor					
DIN IEC 60751	Pt10 (a=0.003850)	-200 to 850 °C (-328 to 1562 °F)	10 °C (18 °F)	±0,80 °C (±1.44 °F)	±0,05 %
	Pt50 (a=0.003850)			±0,16 °C (±0.29 °F)	±0,05 %
	Pt100 (a=0.003850)**			±0,08 °C (±0.14 °F)	±0,05 %
	Pt200 (a=0.003850)			±0,24 °C (±0.43 °F)	±0,05 %
	Pt500 (a=0.003850)			±0,16 °C (±0.29 °F)	±0,05 %
	Pt1000 (a=0.003850)			±0,08 °C (±0.14 °F)	±0,05 %
JIS C1604	Pt10 (a=0.003916)	-200 to 645 °C (-328 to 1193 °F)	10 °C (18 °F)	±0,80 °C (±1.44 °F)	±0,05 %
	Pt50 (a=0.003916)			±0,16 °C (±0.29 °F)	±0,05 %
	Pt100 (a=0.003916)			±0,08 °C (±0.14 °F)	±0,05 %
MIL-T-24388	Pt10 (a=0.003920)	-200 to 850 °C (-328 to 1562 °F)	10 °C (18 °F)	±0,80 °C (±1.44 °F)	±0,05 %
	Pt50 (a=0.003920)			±0,16 °C (±0.29 °F)	±0,05 %
	Pt100 (a=0.003920)			±0,08 °C (±0.14 °F)	±0,05 %
	Pt200 (a=0.003920)			±0,24 °C (±0.43 °F)	±0,05 %
	Pt1000 (a=0.003920)			±0,08 °C (±0.14 °F)	±0,05 %
DIN 43760	Ni50 (a=0.006180)	-60 to 250 °C (-76 to 482 °F)	10 °C (18 °F)	±0,16 °C (±0.29 °F)	±0,05 %
	Ni100 (a=0.006180)			±0,08 °C (±0.14 °F)	±0,05 %
	Ni120 (a=0.006180)				±0,05 %
	Ni1000 (a=0.006180)				±0,05 %
OIML R 84	Cu10 (a=0.004270)	-50 to 200 °C (-58 to 392 °F)	10 °C (18 °F)	±0,80 °C (±1.44 °F)	±0,05 %
	Cu100 (a=0.004270)			±0,08 °C (±0.14 °F)	±0,05 %
	Resistance measurement			0 to 500 Ω	4 Ω
		0 to 5000 Ω	40 Ω	±320 m Ω	±0,05 %

* Percentages refer to the configured measuring span, omitted for PROFIBUS PA® and FOUNDATION Fieldbus®

** Standard Version

... Specification

Sensor	Measuring range limit	Minimum span	Measuring accuracy		
			Input (24-bit AD-converter)	Analog output* (16-Bit D / A-converter)	
Thermocouples** / voltages					
IEC 60584	Type K (Ni10Cr-Ni5)	-270 to 1372 °C (-454 to 2502 °F)	50 °C (90 °F)	±0,35 °C (±0.63 °F)	±0,05 %
	Type J (Fe-Cu45Ni)	-210 to 1200 °C (-346 to 2192 °F)			±0,05 %
	Type N (Ni14CrSi-NiSi)	-270 to 1300 °C (-454 to 2372 °F)			±0,05 %
	Type T (Cu-Cu45Ni)	-270 to 400 °C (-454 to 752 °F)			±0,05 %
	Type E (Ni10Cr-Cu45Ni)	-270 to 1000 °C (-454 to 1832 °F)			±0,05 %
	Type R (Pt13Rh-Pt)	-50 to 1768 °C (-58 to 3215 °F)	100 °C (180 °F)	±0,95 °C (±1.71 °F)	±0,05 %
	Type S (Pt10Rh-Pt)				±0,05 %
	Type B (Pt30Rh-Pt6Rh)	-0 to 1820 °C (32 to 3308 °F)			±0,05 %
DIN 43710	Type L (Fe-CuNi)	-200 to 900 °C (-328 to 1652 °F)	50 °C (90 °F)	±0,35 °C (±0.63 °F)	±0,05 %
	Type U (Cu-CuNi)	-200 to 600 °C (-328 to 1112 °F)			±0,05 %
ASTM E 988	Type C	-0 to 2315 °C (32 to 4200 °F)	100 °C (180 °F)	±1,35 °C (±2.43 °F)	±0,05 %
	Type D				±0,05 %
	Voltage measurement	-125 to 125 mV	2 mV	± 12 µV	±0,05 %
		-125 to 1100 mV	20 mV	± 120 µV	±0,05 %

* Percentages refer to the configured measuring span, omitted for PROFIBUS PA® and FOUNDATION Fieldbus®

** For digital measuring accuracy, the internal reference junction error must be added: Pt1000, DIN IEC 60751 Cl. B

Operating influence

The percentages refer to the configured measuring span.

Input terminal voltage effect / load effect:

Within the specified limit values for the voltage / load, the total influence is less than 0.001% per volt.

Common-mode interference:

No influence up to 100 V_{eff} (50 Hz) or 50 VDC

Ambient temperature effect:

Based on 23 °C (73.4 °F) for an ambient temperature range of -40 to 85 °C (-40 to 185 °F)⁴

Sensor		Ambient temperature effect per 1 °C (1.8 °F) deviation from 23 °C (73.4 °F)	
		Input (24-bit AD-converter)	Analog output ^{1,2} (16-bit DA-converter)
Resistance thermometer for two-, three- and four-wire circuits			
IEC, JIS, MIL	Pt10	±0.04 °C (±0.072 °F)	±0.003 %
	Pt50	±0.008 °C (±0.014 °F)	±0.003 %
	Pt100	±0.004 °C (±0.007 °F)	±0.003 %
IEC, MIL	Pt200	±0.02 °C (±0.036 °F)	±0.003 %
	Pt500	±0.008 °C (±0.014 °F)	±0.003 %
	Pt1000	±0.004 °C (±0.007 °F)	±0.003 %
DIN 43760	Ni50	±0.008 °C (±0.014 °F)	±0.003 %
	Ni100	±0.004 °C (±0.007 °F)	±0.003 %
	Ni120	±0.003 °C (±0.005 °F)	±0.003 %
	Ni1000	±0.004 °C (±0.007 °F)	±0.003 %
OIML R 84	Cu10	±0.04 °C (±0.072 °F)	±0.003 %
	Cu100	±0.004 °C (±0.007 °F)	±0.003 %
Resistance measurement			
	0 to 500 Ω	±0.002 Ω	±0.003 %
	0 to 5000 Ω	±0.02 Ω	±0.003 %
Thermocouple, for all defined types			
		$\pm [(0.001 \% \times (ME[mV] / MS[mv]) + (100 \% \times (0.009 \text{ °C} / MS [\text{°C}]))]^3$	±0.003 %
Voltage measurement			
	-125 to 125 mV	±1.5 μV	±0.003 %
	-125 to 1100 mV	±15 μV	±0.003 %

1 Percentages refer to the configured measuring span of the analog output signal

2 Influence of DA-converter omitted for PROFIBUS PA® and FOUNDATION Fieldbus®

3 ME = voltage value of the thermocouple at the upper range value in accordance with the standard

MA = voltage value of the thermocouple at the lower range value in accordance with the standard

MS = voltage value of the thermocouple over the measuring span in accordance with the standard. MS = (ME - MA)

4 If the optional extended ambient temperature range down to -50 °C (-58 °F) applies, the causal variables are doubled in the range between -50 to -40 °C (-58 to -40 °F)

Electrical connections

Pin assignment

Resistance thermometers (RTD) / resistors (potentiometer)


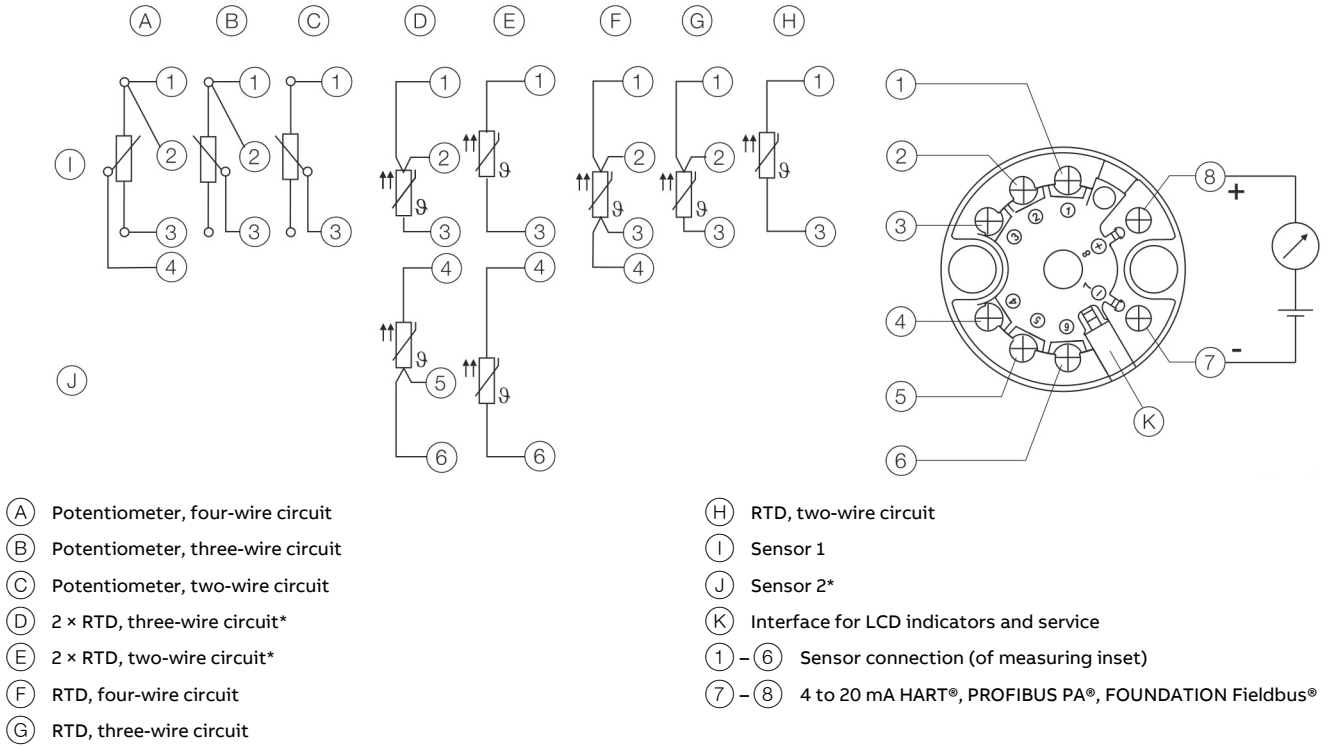


Figure 3: Terminal assignment resistance thermometers (RTD) / resistors (potentiometer)

Thermocouples / voltages and resistance thermometer (RTD) / thermocouple combinations

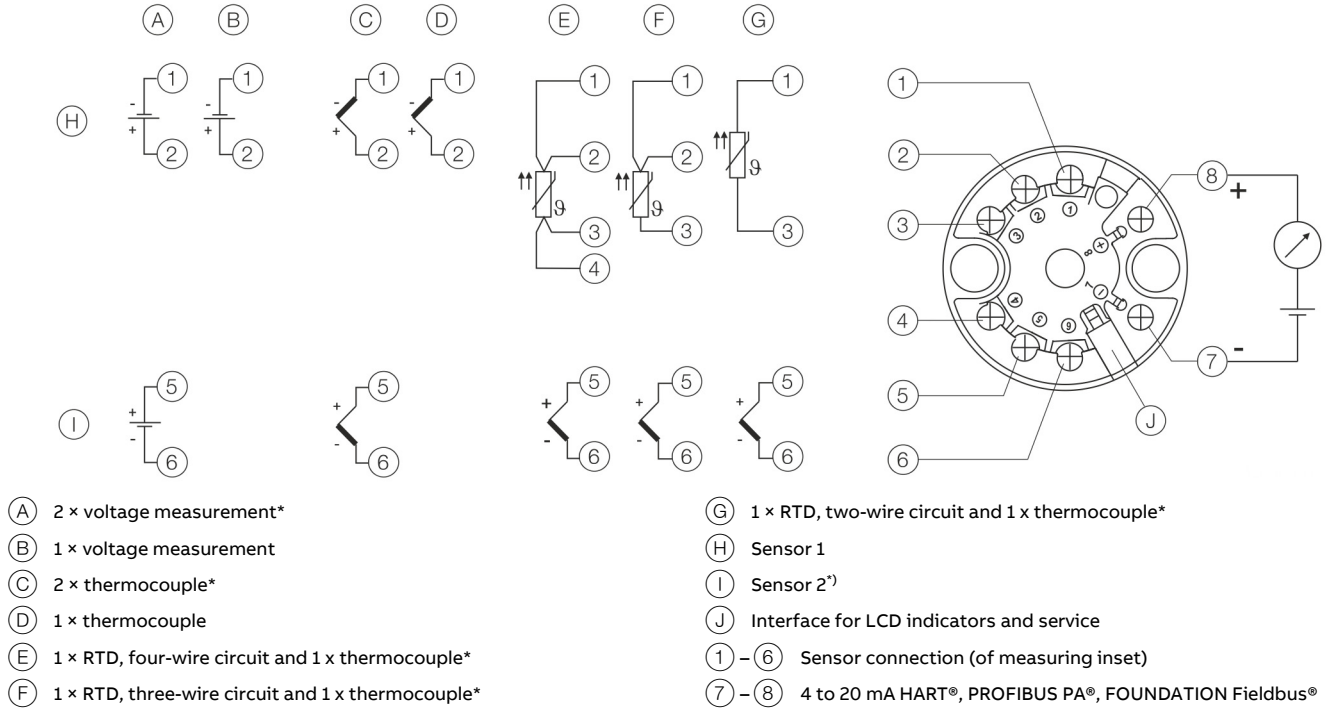

(A) 2 × voltage measurement*

(B) 1 × voltage measurement

(C) 2 × thermocouple*

(D) 1 × thermocouple

(E) 1 × RTD, four-wire circuit and 1 × thermocouple*

(F) 1 × RTD, three-wire circuit and 1 × thermocouple*

(G) 1 × RTD, two-wire circuit and 1 × thermocouple*

(H) Sensor 1

(I) Sensor 2¹⁾

(J) Interface for LCD indicators and service

(1) – (6) Sensor connection (of measuring inset)

(7) – (8) 4 to 20 mA HART®, PROFIBUS PA®, FOUNDATION Fieldbus®

* Sensor backup / sensor redundancy, sensor drift monitoring, mean measurement, or differential measurement

Figure 4 Terminal assignment thermocouples / voltages and resistance thermometer (RTD) / thermocouple combinations

Communication

Configuration parameters

Measurement type

- Sensor type, connection type
- Error signaling
- Measuring range
- General information, e.g. TAG number
- Damping
- Warning and alarm thresholds
- Output signal simulation
- For details, see **Order form configuration** on page 24.

Write protection

Software write protection

Diagnostic information in accordance with NE 107

Standard:

- Sensor error signalling (wire break or short-circuit)
- Device error
- Limit value up-- / down-scaled
- Upper range up- / down-scaled
- Simulation active

Advanced:

- Sensor redundancy / sensor backup active (in case sensor fails) with configurable analog alarm pulse signaling
- Drift monitoring with configurable alarm pulse signaling
- Sensor- / sensor connection lead corrosion
- Supply voltage down-scaled
- Drag indicator for Sensor 1, Sensor 2 and ambient temperature
- Ambient temperature up-scaled
- Ambient temperature down-scaled
- Operating hours counter

HART® Communication

The device is listed with the FieldComm Group.

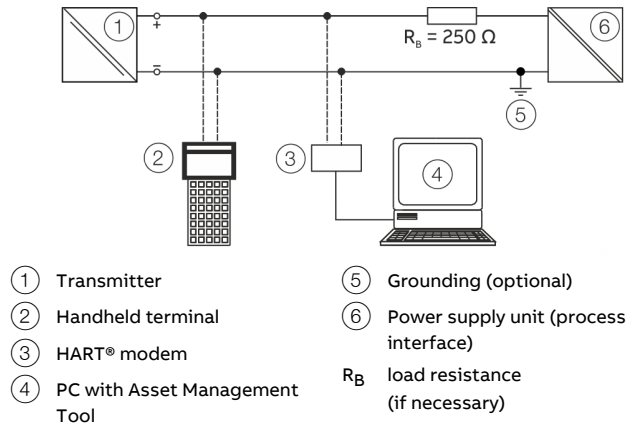


Figure 5: Example for HART® connection

Manufacturer ID	0x1A
Device ID	HART 5: 0x000B, HART 7: 0x1A0B
Profile	HART 5.1 (can be switched to HART 7)
Configuration	On device using LCD indicator DTM, EDD, FDI (FIM)
Transmission signal	BELL Standard 202

Operating modes

- Point-to-point communication mode – standard (general address 0)
- Multidrop mode (addressing 1 to 15)
- Burst Mode

Configuration options / tools

Driver-independent:

- HMI LCD indicator with configuration function

Driver-dependent:

- Device management / Asset management tools
- FDT technology – via TTX300-DTM driver (Asset Vision Basic / DAT200)
- EDD – via TTX300 EDD driver (Handheld terminal, Field Information Manager / FIM)
- FDI technology – via TTX300 package (Field Information Manager / FIM)

Diagnosis notice

- Overrange- / underrange in accordance with NE 43
- HART diagnosis

MID Certification

TTH300 with MID Certification

The temperature transmitter TTH300 is certified by an MID Parts Certificate in accordance with the Measuring Instruments Directive 2014/32/EU (MID) and the standard WELMEC 7.2. The device with the appropriate configuration is therefore approved for 'Custody Transfer'-measurements (fiscal metering).

The MID certification emphasizes the high accuracy, reliability and durability of the TTH300.

Note

This chapter provides basic information on the MID-certified transmitter TTH300. Before commissioning the device, full information should be consulted in the supplied MID documents (Parts Certificate and associated 'Description'). Any generally applicable statements on the transmitter TTH300, especially pertaining to explosion protection and device safety, remain unaffected.

General

Devices with MID certification have their own EU declaration of conformity. In addition to the declaration, the 'Parts Certificate' and the associated 'Description' are enclosed with the device.

It is compulsory and imperative that the described areas of application, requirements and restrictions are complied with for the intended use of the device!

The requirements of explosion protection and functional safety (SIL) remain unaffected by the MID certification.

The number of the partial certificate (TC11002) of the notified body NMI Certin B.V. and the checksum (0x46c9) of the certified SW revision 01.03.00 are printed on the name plate of the device.

Areas of application, conditions and requirements

The temperature transmitter TTH300 with MID certification for custody transfer measurements is especially suited for measurement and control systems in the oil and gas industry. In addition to gas, any liquids except for water are permitted for measurement.

The MID certification refers to a special configuration of the transmitter. This must not be modified! An extract of the conditions and requirements stated in the certificate follows below:

- Communication protocol: HART 5, HART 7
- HW revision: 1.07
- SW revision: 01.03.00 with checksum 0x46c9
- The checksum of the software (firmware) is printed on the name plate of the device
- On sensor Pt100 in a four-wire circuit
- Permissible measuring range:
–50 to 150 °C (–58 to 302 °F)
- Ambient temperature range without LCD indicator:
–40 to 85 °C (–40 to 185 °F)

Note

- Based on the MID certificate, an operation of the TTH300 with the connected LCD indicator is not permitted.
- The MID certification can generally be combined with all certifications of explosion protection.
The ambient temperature and measuring range named in the corresponding explosion protection certificate, however, limit the ranges permitted in the MID certificate.

Note

The HW write protection on the device should be activated after installation and configuration. The housing cover should be secured and the device housing sealed using the supplied seal.

Dimensions

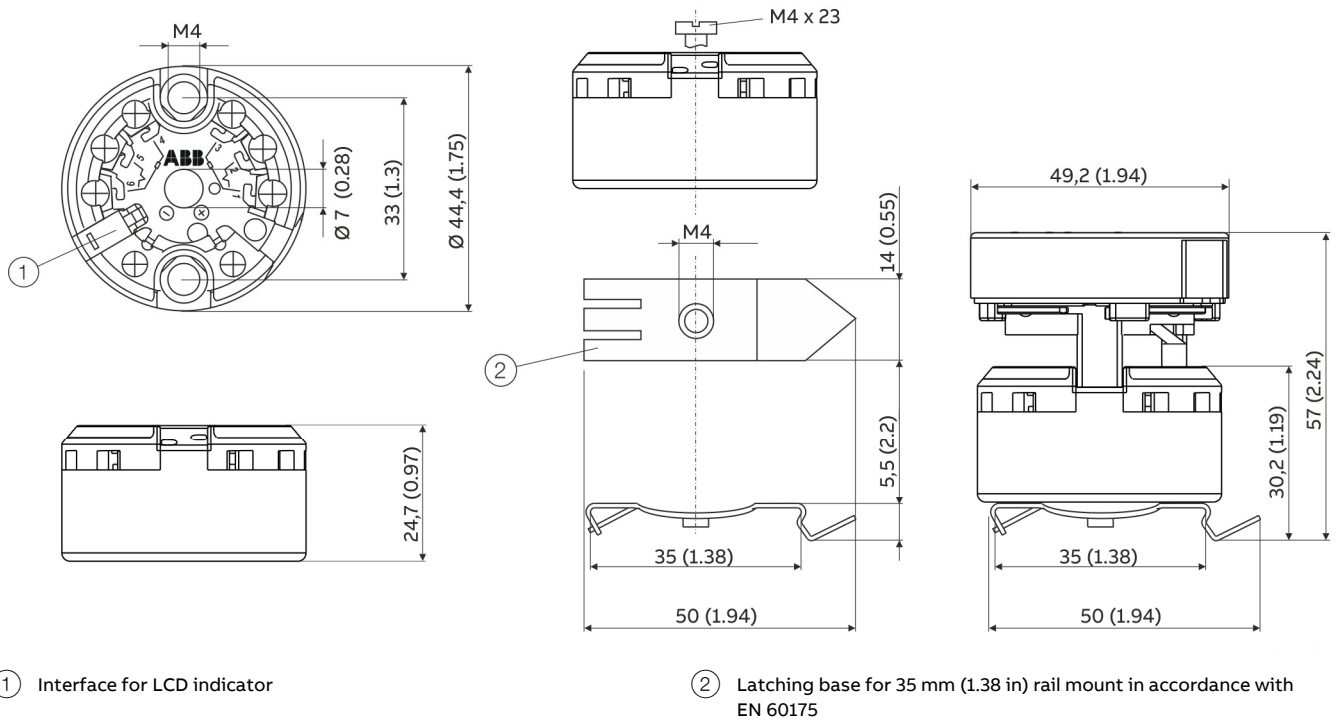


Figure 8: Dimensions in mm (in)

Use in potentially explosive atmospheres in accordance with ATEX and IECEx

Note

- Further information on the approval of devices for use in potentially explosive atmospheres can be found in the explosion protection test certificates (at www.abb.com/temperature).
- Depending on the design, a specific marking in accordance with ATEX or IECEx applies.

Ex marking

Transmitter

ATEX intrinsic safety

The device fulfills the requirements of Directive 2014/34/EU in case of corresponding purchase orders and is approved for use in Zone 0, 1 and 2.

Model TTH300-E1H

Type Examination Test Certificate	PTB 05 ATEX 2017 X
II 1 G Ex ia IIC T6 Ga	
II 2 (1) G Ex [ja IIC Ga] ib IIC T6 Gb	
II 2 G (1D) Ex [ja IIIC Da] ib IIC T6 Gb	

Model TTH300-E1P and TTH300-E1F

Type Examination Test Certificate	PTB 09 ATEX 2016 X
II 1 G Ex ia IIC T6 Ga	
II 2 (1) G Ex [ja IIC Ga] ib IIC T6 Gb	
II 2 G (1D) Ex [ja IIIC Da] ib IIC T6 Gb	

Non-sparking ATEX

The device fulfills the requirements of Directive 2014/34/EU in case of corresponding purchase orders and is approved for use in Zone 2.

Model TTH300-E2X

Declaration of conformity	
II 3 G Ex nA IIC T1-T6 Gc	

IECEx intrinsic safety

Approved for use in Zone 0, 1, and 2.

Model TTH300-H1H

IECEx certificate of conformity	IECEx PTB 09.0014X
---------------------------------	--------------------

Model TTH300-H1P and TTH300-H1F

IECEx certificate of conformity	IECEx PTB 11.0108X
Ex ia IIC T6...T1 Ga	
Ex [ja IIC Ga] ib IIC T6...T1 Gb	
Ex [ja IIIC Da] ib IIC T6...T1 Gb	

LCD indicator

ATEX intrinsic safety

The device fulfills the requirements of Directive 2014/34/EU in case of corresponding purchase orders and is approved for use in Zone 0, 1 and 2.

Type Examination Test Certificate	PTB 05 ATEX 2079 X
II 1G Ex ia IIC T6 Ga	

Non-sparking ATEX

The device fulfills the requirements of Directive 2014/34/EU in case of corresponding purchase orders and is approved for use in Zone 2.

Declaration of conformity

II 3 G Ex nA IIC T1-T6 Gc	
---------------------------	--

IECEx intrinsic safety

Approved for use in Zone 0, 1, and 2.

IECEx certificate of conformity	IECEx PTB 12.0028X
Ex ia IIC T6	

Temperature data

Transmitter

ATEX/IECEx intrinsic safety, non-sparking ATEX

Temperature class	Permissible ambient temperature range	
	Device category 1 use	Device category 2 / 3 use
T6	-50 to 44 °C (-58 to 111.2 °F)	-50 to 56 °C (-58 to 132.8 °F)
T5	-50 to 56 °C (-58 to 132.8 °F)	-50 to 71 °C (-58 to 159.8 °F)
T4-T1	-50 to 60 °C (-58 to 140.0 °F)	-50 to 85 °C (-58 to 185.0 °F)

LCD indicator

ATEX/IECEx intrinsic safety, non-sparking ATEX

Temperature class	Permissible ambient temperature range	
	Device category 1 use	Device category 2 / 3 use
T6	-40 to 44 °C (-40 to 111.2 °F)	-40 to 56 °C (-40 to 132.8 °F)
T5	-40 to 56 °C (-40 to 132.8 °F)	-40 to 71 °C (-40 to 159.8 °F)
T4-T1	-40 to 60 °C (-40 to 140 °F)	-40 to 85 °C (-40 to 185 °F)

Electrical data

Transmitter

Intrinsic safety type of protection Ex ia IIC (part 1)

Power supply circuit*	TTH300-E1H		TTH300-E1P/-H1P	
	TTH300-H1H		TTH300-E1F/-H1F	
	FISCO*		ENTITY	
Max. voltage	$U_i = 30 \text{ V}$	$U_i \leq 17.5 \text{ V}$	$U_i \leq 24.0 \text{ V}$	
Short-circuit current	$I_i = 130 \text{ mA}$	$I_i \leq 183 \text{ mA}^{**}$	$I_i \leq 250 \text{ mA}$	
Max. power	$P_i = 0.8 \text{ W}$	$P_i \leq 2.56 \text{ W}^{**}$	$P_i \leq 1.2 \text{ W}$	
Internal inductance	$L_i = 0.5 \text{ mH}$	$L_i \leq 10 \mu\text{H}$	$L_i \leq 10 \mu\text{H}$	
Internal capacitance	$C_i = 0.57 \text{ nF}^{***}$	$C_i \leq 5 \text{ nF}$	$C_i \leq 5 \text{ nF}$	

* FISCO in accordance with 60079-27

** II B FISCO: $I_i \leq 380 \text{ mA}$, $P_i \leq 5.32 \text{ W}$

*** Only applies for HART variants. From HW Rev. 1.07, previously 5 nF

Intrinsic safety type of protection Ex ia IIC (part 2)

Measurement current circuit

	Resistance thermometers, resistors	Thermocouples, voltages
Max. voltage	$U_o = 6.5 \text{ V}$	$U_o = 1.2 \text{ V}$
Short-circuit current	$I_o = 25 \text{ mA}$	$I_o = 50 \text{ mA}$
Max. power	$P_o = 38 \text{ mW}$	$P_o = 60 \text{ mW}$
Internal inductance	$L_i = 0 \text{ mH}$	$L_i = 0 \text{ mH}$
Internal capacitance	$C_i = 49 \text{ nF}$	$C_i = 49 \text{ nF}$
Maximum permissible external inductance	$L_o = 5 \text{ mH}$	$L_o = 5 \text{ mH}$
Maximum permissible external capacitance	$C_o = 1.55 \mu\text{F}$	$C_o = 1.05 \mu\text{F}$

Intrinsic safety type of protection Ex ia IIC (part 3)

LCD indicator interface

Max. voltage	$U_o = 6.2 \text{ V}$
Short-circuit current	$I_o = 65.2 \text{ mA}$
Max. power	$P_o = 101 \text{ mW}$
Internal inductance	$L_i = 0 \text{ mH}$
Internal capacitance	$C_i = 0 \text{ nF}$
Maximum permissible external inductance	$L_o = 5 \text{ mH}$
Maximum permissible external capacitance	$C_o = 1.4 \mu\text{F}$

LCD indicator

Intrinsic safety type of protection Ex ia IIC

Supply circuit

Max. voltage	$U_i = 9 \text{ V}$
Short-circuit current	$I_i = 65.2 \text{ mA}$
Max. power	$P_i = 101 \text{ mW}$
Internal inductance	$L_i = 0 \text{ mH}$
Internal capacitance	$C_i = 0 \text{ nF}$

Use in potentially explosive atmospheres in accordance with FM and CSA

Note

- Further information on the approval of devices for use in potentially explosive atmospheres can be found in the explosion protection test certificates (at www.abb.com/temperature).
- Depending on the design, a specific marking in accordance with FM or CSA applies.

Ex marking

Transmitter

FM Intrinsically Safe

Model TTH300-L1H	
Control Drawing	SAP_214829
Model TTH300-L1P	
Control Drawing	TTH300-L1P (IS)
Model TTH300-L1F	
Control Drawing	TTH300-L1F (IS)
Class I, Div. 1 + 2, Groups A, B, C, D	
Class I, Zone 0, AEx ia IIC T6	

FM Non-Incendive

Model TTH300-L2H	
Control Drawing	214831 (Non-Incendive)
Model TTH300-L2P	
Control Drawing	TTH300-L2P (NI_PS) TTH300-L2P (NI_AA)
Model TTH300-L2F	
Control Drawing	TTH300-L2F (NI_PS) TTH300-L2F (NI_AA)
Class I, Div. 2, Groups A, B, C, D	

CSA Intrinsically Safe

Model TTH300-R1H	
Control Drawing	214826
Model TTH300-R1P	
Control Drawing	TTH300-R1P (IS)
Model TTH300-R1F	
Control Drawing	TTH300-R1F (IS)
Class I, Div. 1 + 2, Groups A, B, C, D	
Class I, Zone 0, Ex ia Group IIC T6	

CSA Non-Incendive

Model TTH300-R2H	
Control Drawing	SAP_214824 (Non-Incendive) SAP_214896 (Non-Incendive)
Model TTH300-R2P	
Control Drawing	TTH300-R2P (NI_PS) TTH300-R2P (NI_AA)
Model TTH300-R2F	
Control Drawing	TTH300-R2F (NI_PS) TTH300-R2F (NI_AA)
Class I, Div. 2, Groups A, B, C, D	

LCD indicator

FM Intrinsically Safe

Control Drawing	SAP_214 748
I.S. Class I Div 1 and Div 2, Group: A, B, C, D or	
I.S. Class I Zone 0 AEx ia IIC T*	
$U_i / V_{max} = 9 V, I_i / I_{max} < 65.2 \text{ mA}, P_i = 101 \text{ mW}, C_i = 0.4 \mu\text{F}, L_i = 0$	

FM Non-Incendive

Control Drawing	SAP_214 751
N.I. Class I Div 2, Group: A, B, C, D oder Ex nL IIC T**, Class I Zone 2	
$U_i / V_{max} = 9 V, I_i / I_{max} < 65.2 \text{ mA}, P_i = 101 \text{ mW}, C_i = 0.4 \mu\text{F}, L_i = 0$	

CSA Intrinsically Safe

Control Drawing	SAP_214 749
I.S. Class I Div 1 and Div 2; Group: A, B, C, D or	
I.S. Zone 0 Ex ia IIC T*	
$U_i / V_{max} = 9 V, I_i / I_{max} < 65.2 \text{ mA}, P_i = 101 \text{ mW}, C_i < 0.4 \mu\text{F}, L_i = 0$	

CSA Non-Incendive

Control Drawing	SAP_214 750
N.I. Class I Div 2, Group: A, B, C, D oder Ex nL IIC T**, Class I Zone 2	
$U_i / V_{max} = 9 V, I_i / I_{max} < 65.2 \text{ mA}, P_i = 101 \text{ mW}, C_i < 0.4 \mu\text{F}, L_i = 0$	
* Temp. Ident: T6 T _{amb} 56 °C, T4 T _{amb} 85 °C	
** Temp. Ident: T6 T _{amb} 60 °C, T4 T _{amb} 85 °C	

Ordering Information

TTH300

Base model	TTH300	XX	X	X
TTH300 Head Mounted Temperature Transmitter, Pt100 (RTD), thermocouples, electrical isolation				
Explosion Protection				
Without explosion protection			Y0	
ATEX Intrinsic Safety type of protection: Zone 0: II 1 G Ex ia IIC T6 Ga, Zone 1 (0): II 2 (1) G Ex [ia IIC Ga] ib IIC T6 Gb, Zone 1 (20): II 2 G (1D) Ex [ia IIIC Da] ib IIC T6 Gb			E1	
ATEX Non-sparking type of protection: Zone 2: II 3 G Ex nA IIC T1-T6 Gc			E2	
IECEX Intrinsic Safety type of protection: Zone 0: Zone 0: Ex ia IIC T6 Ga, Zone 1 (0): Ex [ia IIC Ga] ib IIC T6 Gb, Zone 1 (20): Ex [ia IIIC Da] ib IIC T6 Gb Zone 1 (20): Ex [ia IIIC Da] ib IIC T6 Gb			H1	
FM Intrinsic Safety (IS): Class I, Div. 1+2, Groups A, B, C, D, Class I, Zone 0, AEx ia IIC T6			L1	
FM Non-incendive (NI): Class I, Div. 2, Groups A, B, C, D oder Class I Zone 2 Group IIC T6			L2	
CSA Intrinsic Safety (IS): Class I, Div. 1+2, Groups A, B, C, D, Class I, Zone 0, Ex ia IIC			R1	
CSA Non-incendive (NI): Class I, Div. 2, Groups A, B, C, D			R2	
GOST Russia - metrological approval			G1	
GOST Russia - metrological approval and EAC-Ex, Ex i - Zone 0			P2	
GOST Kazakhstan - metrological approval			G3	
GOST Kazakhstan - metrological approval and EAC-Ex, Ex i - Zone 0			T2	
GOST Belarus - metrological approval			M5	
GOST Belarus - metrological approval and EAC-Ex, Ex i - Zone 0			U2	
Inmetro Ex ia IIC T6...T4 Ga, Ex ib [ia Ga] IIC T6...T4 Gb Exib [ia IIIC Da] IIC T6...T4 Gb			C1	
KOSHA Ex ia IIC T6			S5	
Communication Protocol				
HART				H
PROFIBUS PA				P
FOUNDATION Fieldbus				F
Configuration				
Standard configuration				BS
Customer-specific configuration with report, except user curve				BF*
Customer-specific configuration with report, including user curve				BG

* E.g. set measuring range, TAG no.

... Ordering Information

Additional ordering information TTH300

Additional ordering information	XX	XX	XXX	XX	XX	XX	XX	XX
Declarations and Certificates								
SIL2 - Declaration of Conformity	CS*							
Declaration of compliance according EN 10204-2.1, with the order	C4							
Inspection certificate according EN 10204-3.1, visual, dimensional and functional test	C6							
MID Parts Certificate for Custody Transfer	CO*							
Calibration Certificates								
With 5-point factory certificate		EM						
Inspection certificate according EN 10204-3.1, 5-point calibration		EP						
Handling of Certificates								
Send via e-mail			GHE					
Send via mail			GHP					
Send via mail express			GHD					
Send with instrument			GHA					
Only archived			GHS					
Extended Ambient Temperature Range								
-50 to 85 °C (-58 to 185 °F)					SE			
Field Housing								
Aluminium field housing 80 × 75 × 57 mm, IP 65, including 2 pieces M16 cable glands							H1**	
Polyester field housing 75 × 80 × 55 mm, IP 65, including 2 pieces M16 cable glands							H2**	
Polycarbonate field housing 80 × 82 × 55 mm, IP 65, including 2 pieces M16 cable glands							H3**	
Aluminium field housing 175 × 80 × 57 mm without separate terminal block, IP 65, including 2 pieces M16 and 1 piece M20 cable glands							H6**	
Polyester field housing 190 × 75 × 55 mm with separate terminal block, IP 65, including 2 pieces M16 and 1 piece M20 cable glands							H7**	
Polyester field housing 190 × 75 × 55 mm without separate terminal block, IP 65, including 2 pieces M16 and 1 piece M20 cable glands							H8**	
Display Options								
Prepared for display								D1
Not prepared for display								D2
LCD indicator type AS								D3
Configurable LCD indicator type A								D4
Mounting Options								
Snap-on fixing set for 35 mm rail acc. EN 60175 (incl. fixing screws)								SF
Customer-specific Versions								
(Please specify)								

* Only available with Communication Protocol code H (HART)

** Not available with Explosion Protection

Additional ordering information TTH300		XX
Documentation Language		
German		M1
English		M5
Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV)		MW
Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG)		ME

Accessories	Order code
TTH Snap-on fixing set (packing unit 10 pieces), for 35 mm rail acc. EN 60175 (incl. fixing screws)	3KXT091230L0001
TTH Snap-on fixing set (packing unit 1 piece), for 35 mm rail acc. EN 60175 (incl. fixing screws)	3KXT091230L0002
TTH300 Commissioning Instruction, German	3KXT231001R4403
TTH300 Commissioning Instruction, English	3KXT231001R4401
TTH300 Commissioning Instruction, Language package Western Europe / Scandinavia	3KXT231001R4493
TTH300 Commissioning Instruction, Language package Eastern Europe	3KXT231001R4494

Order form configuration

HART device design

Customer-specific configuration	Selection
Number of sensors	<input type="checkbox"/> 1 sensor (standard) <input type="checkbox"/> 2 sensors
Measurement type (for 2-sensor selection only)	<input type="checkbox"/> Sensor redundancy / sensor backup <input type="checkbox"/> Sensor drift monitoring ____ °C / K sensor drift differential ____ s time limit for drift overshoot <input type="checkbox"/> Differential measurement: zero point where $I_a = 4$ mA <input type="checkbox"/> Differential measurement: zero point where $I_a = 12$ mA <input type="checkbox"/> Average measurement
IEC 60751 Resistance thermometer	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 (Standard) <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt500 <input type="checkbox"/> Pt1000
JIS C1604	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100
MIL-T-24388	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt1000
DIN 43760	<input type="checkbox"/> Ni50 <input type="checkbox"/> Ni100 <input type="checkbox"/> Ni120 <input type="checkbox"/> Ni1000
OIML R 84	<input type="checkbox"/> Cu10 <input type="checkbox"/> Cu100
Resistance measurement	<input type="checkbox"/> 0 to 500 Ω <input type="checkbox"/> 0 to 5000 Ω
IEC 60584 Thermocouple	<input type="checkbox"/> Type K <input type="checkbox"/> Type J <input type="checkbox"/> Type N <input type="checkbox"/> Type R <input type="checkbox"/> Type S <input type="checkbox"/> Type T <input type="checkbox"/> Type E <input type="checkbox"/> Type B
DIN 43710	<input type="checkbox"/> Type L <input type="checkbox"/> Type U
ASTM E-988	<input type="checkbox"/> Type C <input type="checkbox"/> Type D
Voltage measurement	<input type="checkbox"/> -125 to 125 mV <input type="checkbox"/> -125 to 1100 mV
Sensor circuit (for resistance thermometer and resistance measurement only)	<input type="checkbox"/> Two-wire <input type="checkbox"/> Three-wire (standard) <input type="checkbox"/> Four-wire Two-wire circuit: Compensation of sensor-wire resistance max. 100 Ω <input type="checkbox"/> <input type="checkbox"/> Sensor 1: ____ Ω <input type="checkbox"/> Sensor 2: ____ Ω
Reference junction (for thermocouples only)	<input type="checkbox"/> Internal (for standard thermocouple, except type B) <input type="checkbox"/> None (type B) <input type="checkbox"/> External / temperature: ____ °C
Measuring range	<input type="checkbox"/> Lower range value : _____ (standard: 0) <input type="checkbox"/> Upper range value : _____ (standard: 100)
Unit	<input type="checkbox"/> Celsius (default) <input type="checkbox"/> Fahrenheit <input type="checkbox"/> Rankine <input type="checkbox"/> Kelvin
Characteristic behavior	<input type="checkbox"/> rising 4 to 20 mA (standard) <input type="checkbox"/> falling 20 to 4 mA
Output behavior for error	<input type="checkbox"/> Overrange / 22 mA (standard) <input type="checkbox"/> Underrange / 3.6 mA
Output damping (T_{63})	<input type="checkbox"/> Off (standard) <input type="checkbox"/> ____ seconds (1 to 100 s)
Sensor number	<input type="checkbox"/> Sensor 1: _____ <input type="checkbox"/> Sensor 2: _____
Resistor value at 0 °C / R_0	Sensor 1: R_0 : _____ Sensor 2: R_0 : _____
Callendar-Van Dusen coefficient A	A: _____ A: _____
Callendar-Van Dusen coefficient B	B: _____ B: _____
Callendar-Van Dusen coefficient C	C: _____ C: _____
(optional, for resistance thermometers only)	
User characteristics based on linearization table	<input type="checkbox"/> Based on attached table of variate pairs
TAG number	<input type="checkbox"/> _____ (maximum 8 characters)
HART revision	<input type="checkbox"/> HART5 (standard) <input type="checkbox"/> HART7
Software write protection	<input type="checkbox"/> Off (standard) <input type="checkbox"/> On
'Maintenance required' alarm pulse or continuous signaling in accordance with NE 107	<input type="checkbox"/> Off (standard) pulse width ____ s (0.5 to 59.5 s increment 0.5 s)

PROFIBUS PA / FOUNDATION Fieldbus device design

Customer-specific configuration		Selection	
Number of sensors		<input type="checkbox"/> 1 sensor (standard)	<input type="checkbox"/> 2 sensors
Measurement type (for 2-sensor selection only)		<input type="checkbox"/> Sensor redundancy / sensor backup <input type="checkbox"/> Sensor drift monitoring ____ °C / K sensor drift differential ____ s time limit for drift overshoot <input type="checkbox"/> Differential measurement: zero point where Ia = 4 mA <input type="checkbox"/> Differential measurement: zero point where Ia = 12 mA <input type="checkbox"/> Average measurement	
IEC 60751	Resistance thermometer	<input type="checkbox"/> Pt10	<input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 (Standard) <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt500 <input type="checkbox"/> Pt1000
JIS C1604		<input type="checkbox"/> Pt10	<input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100
MIL-T-24388		<input type="checkbox"/> Pt10	<input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt1000
DIN 43760		<input type="checkbox"/> Ni50	<input type="checkbox"/> Ni100 <input type="checkbox"/> Ni120 <input type="checkbox"/> Ni1000
OIML R 84		<input type="checkbox"/> Cu10	<input type="checkbox"/> Cu100
Resistance measurement		<input type="checkbox"/> 0 to 500 Ω	<input type="checkbox"/> 0 to 5000 Ω
IEC 60584	Thermocouple	<input type="checkbox"/> Type K	<input type="checkbox"/> Type J <input type="checkbox"/> Type N <input type="checkbox"/> Type R <input type="checkbox"/> Type S <input type="checkbox"/> Type T <input type="checkbox"/> Type E <input type="checkbox"/> Type B
DIN 43710		<input type="checkbox"/> Type L	<input type="checkbox"/> Type U
ASTM E-988		<input type="checkbox"/> Type C	<input type="checkbox"/> Type D
Voltage measurement		<input type="checkbox"/> -125 to 125 mV	<input type="checkbox"/> -125 to 1100 mV
Sensor circuit (for resistance thermometer and resistance measurement only)		<input type="checkbox"/> Two-wire <input type="checkbox"/> Three-wire (standard) <input type="checkbox"/> Four-wire Two-wire circuit: Compensation of sensor-wire resistance max. 100 Ω <input type="checkbox"/> <input type="checkbox"/> Sensor 1: ____ Ω <input type="checkbox"/> Sensor 2: ____ Ω	
Reference junction (for thermocouples only)		<input type="checkbox"/> Internal (for standard thermocouple, except type B) <input type="checkbox"/> None (type B) <input type="checkbox"/> External / temperature: ____ °C	
Unit		<input type="checkbox"/> Celsius (default) <input type="checkbox"/> Fahrenheit <input type="checkbox"/> Rankine <input type="checkbox"/> Kelvin	
Resistor value at 0 °C / R ₀		Sensor 1: R ₀ :	_____ Sensor 2: R ₀ :
Callendar-Van Dusen coefficient A		A:	_____ A:
Callendar-Van Dusen coefficient B		B:	_____ B:
Callendar-Van Dusen coefficient C		C:	_____ C:
(optional, for resistance thermometers only)			
IDENT_number (PROFIBUS)		<input type="checkbox"/> device-specific 0x3470 (standard)	<input type="checkbox"/> profile 0x9700 (1 AI Block)
Bus address PROFIBUS PA		<input type="checkbox"/> PA: 0 to 125	<input type="checkbox"/> Standard PA: 126
TAG number		<input type="checkbox"/> _____ (maximum 16 characters)	
Software write protection		<input type="checkbox"/> Off (standard)	<input type="checkbox"/> On

Trademarks

HART is a registered trademark of FieldComm Group, Austin, Texas, USA

PROFIBUS and PROFIBUS PA are registered trademarks of PROFIBUS & PROFINET International (PI)

FOUNDATION Fieldbus is a registered trademark of FieldComm Group, Austin, Texas, USA.

Sales



Service



ABB Limited**Measurement & Analytics**

Howard Road, St. Neots
Cambridgeshire, PE19 8EU
UK

Tel: +44 (0)870 600 6122

Fax: +44 (0)1480 213 339

Email: enquiries.mp.uk@gb.abb.com

ABB Inc.**Measurement & Analytics**

125 E. County Line Road
Warminster, PA 18974
USA

Tel: +1 215 674 6000

Fax: +1 215 674 7183

ABB Automation Products GmbH**Measurement & Analytics**

Schillerstr. 72
32425 Minden
Germany

Tel: +49 571 830-0

Fax: +49 571 830-1806

abb.com/temperature

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail.
ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.